




RADON INSPECTION REPORT

Document Generated

07 / 29 / 2021

Document Number

RP22105180026_27Jul21_1454

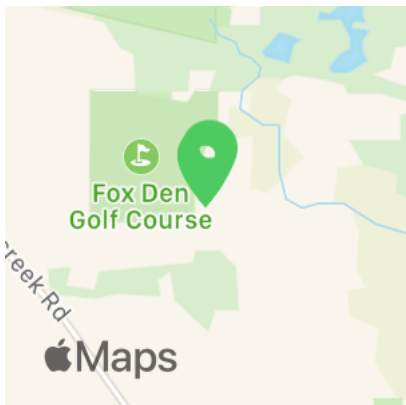

Device S/N

RP22105180026

Measurement Date

07/27/2021 - 07/29/2021

Inspection Duration

48 Hour (Data No: 48)

Inspector

Nate Dujanovic

Inspector Phone

(330) 554-9498

Test Started
07/27/2021 14:55

Test Ended
07/29/2021 14:55

Inspection Duration
48 Hours

Calibrated
05/18/2021 14:12

Wait Time
0 Hours

Radon Concentration Max
6.7

Radon Concentration Min
3.3

Overall Avg
5.1

EPA Protocol Average
5.2

NOTE: The calibrated EPA average excludes the first 4 measures to follow EPA Protocol

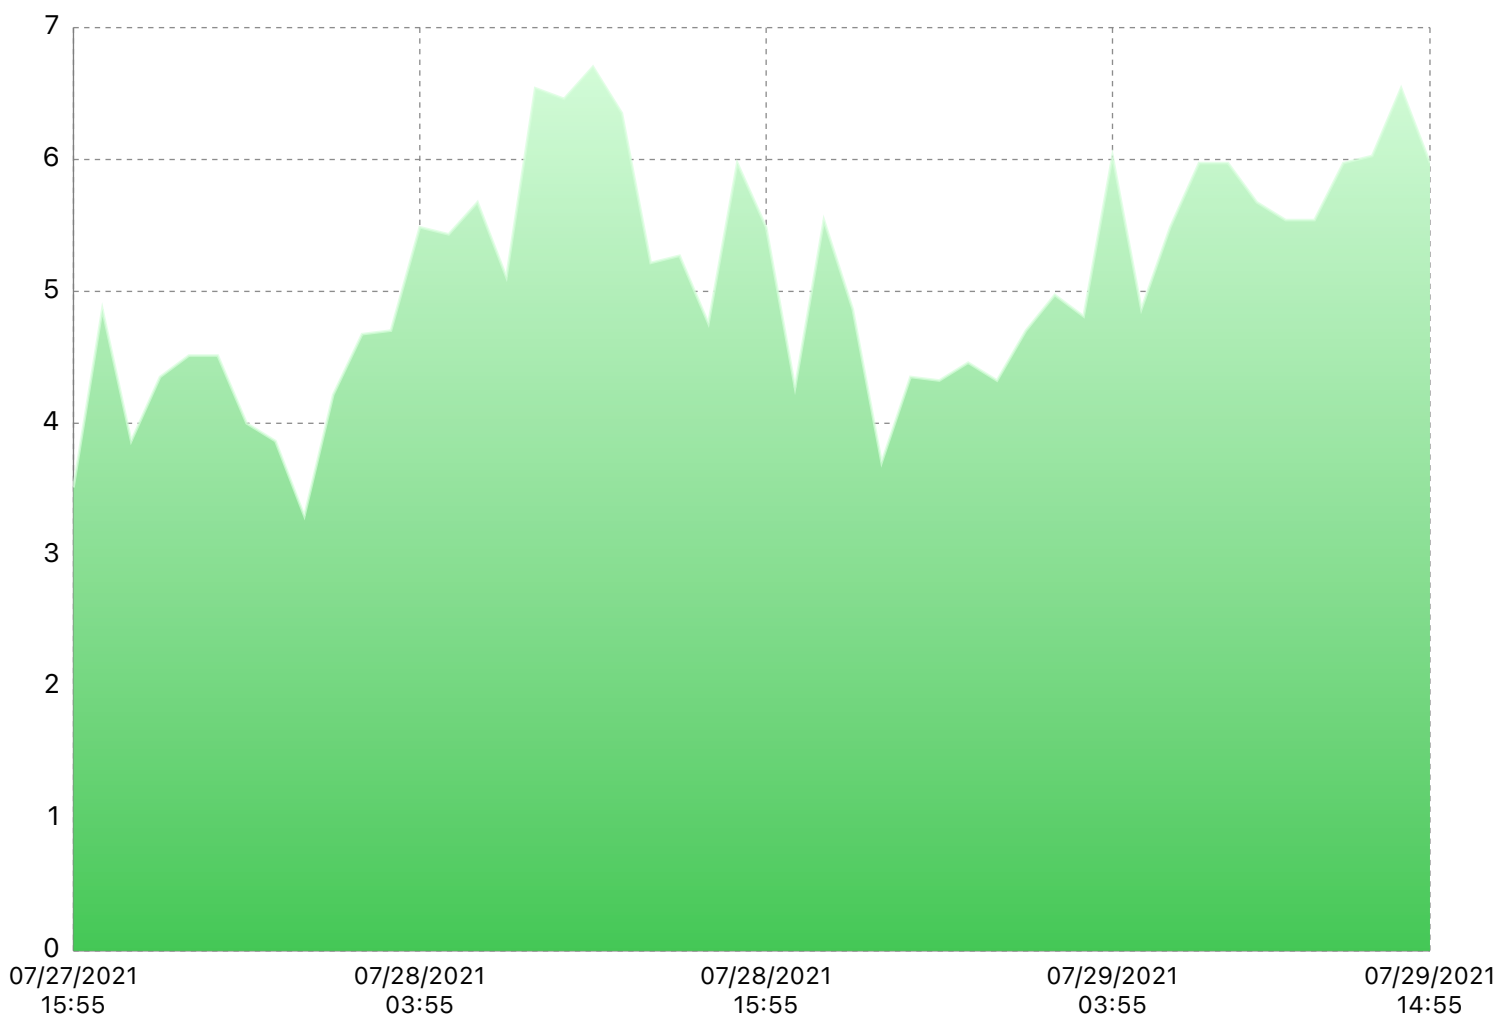


Table of Hourly Radon Measurements

Radon Concentration Average: 5.1 pCi/L

Timestamp	Radon Value	Temp(F)	RH(%)	Timestamp	Radon Value	Temp(F)	RH(%)
07/27/21 15:55	3.5	68	68	07/28/21 15:55	5.5	69	65
07/27/21 16:55	4.9	68	65	07/28/21 16:55	4.3	69	63
07/27/21 17:55	3.9	68	65	07/28/21 17:55	5.5	69	64
07/27/21 18:55	4.4	69	66	07/28/21 18:55	4.9	69	64
07/27/21 19:55	4.5	69	66	07/28/21 19:55	3.7	69	64
07/27/21 20:55	4.5	70	66	07/28/21 20:55	4.4	70	64
07/27/21 21:55	4.0	70	67	07/28/21 21:55	4.3	70	65
07/27/21 22:55	3.9	70	67	07/28/21 22:55	4.5	70	65
07/27/21 23:55	3.3	70	66	07/28/21 23:55	4.3	70	64
07/28/21 00:55	4.2	70	66	07/29/21 00:55	4.7	70	65
07/28/21 01:55	4.7	71	65	07/29/21 01:55	5.0	71	64
07/28/21 02:55	4.7	71	65	07/29/21 02:55	4.8	71	64
07/28/21 03:55	5.5	71	65	07/29/21 03:55	6.0	71	64
07/28/21 04:55	5.4	71	65	07/29/21 04:55	4.9	71	64
07/28/21 05:55	5.7	71	65	07/29/21 05:55	5.5	71	64
07/28/21 06:55	5.1	71	64	07/29/21 06:55	6.0	71	64
07/28/21 07:55	6.5	71	64	07/29/21 07:55	6.0	71	64
07/28/21 08:55	6.5	71	64	07/29/21 08:55	5.7	71	64
07/28/21 09:55	6.7	70	64	07/29/21 09:55	5.5	71	64
07/28/21 10:55	6.4	70	65	07/29/21 10:55	5.5	72	64
07/28/21 11:55	5.2	70	65	07/29/21 11:55	6.0	72	64
07/28/21 12:55	5.3	69	66	07/29/21 12:55	6.0	71	65
07/28/21 13:55	4.8	69	66	07/29/21 13:55	6.5	70	65
07/28/21 14:55	6.0	70	66	07/29/21 14:55	6.0	71	66

* Temperature and humidity can vary depending on environmental conditions.